


# BOWIE-CASS ELECTRIC COOPERATIVE, INC.

## TEMPORARY METER POLE

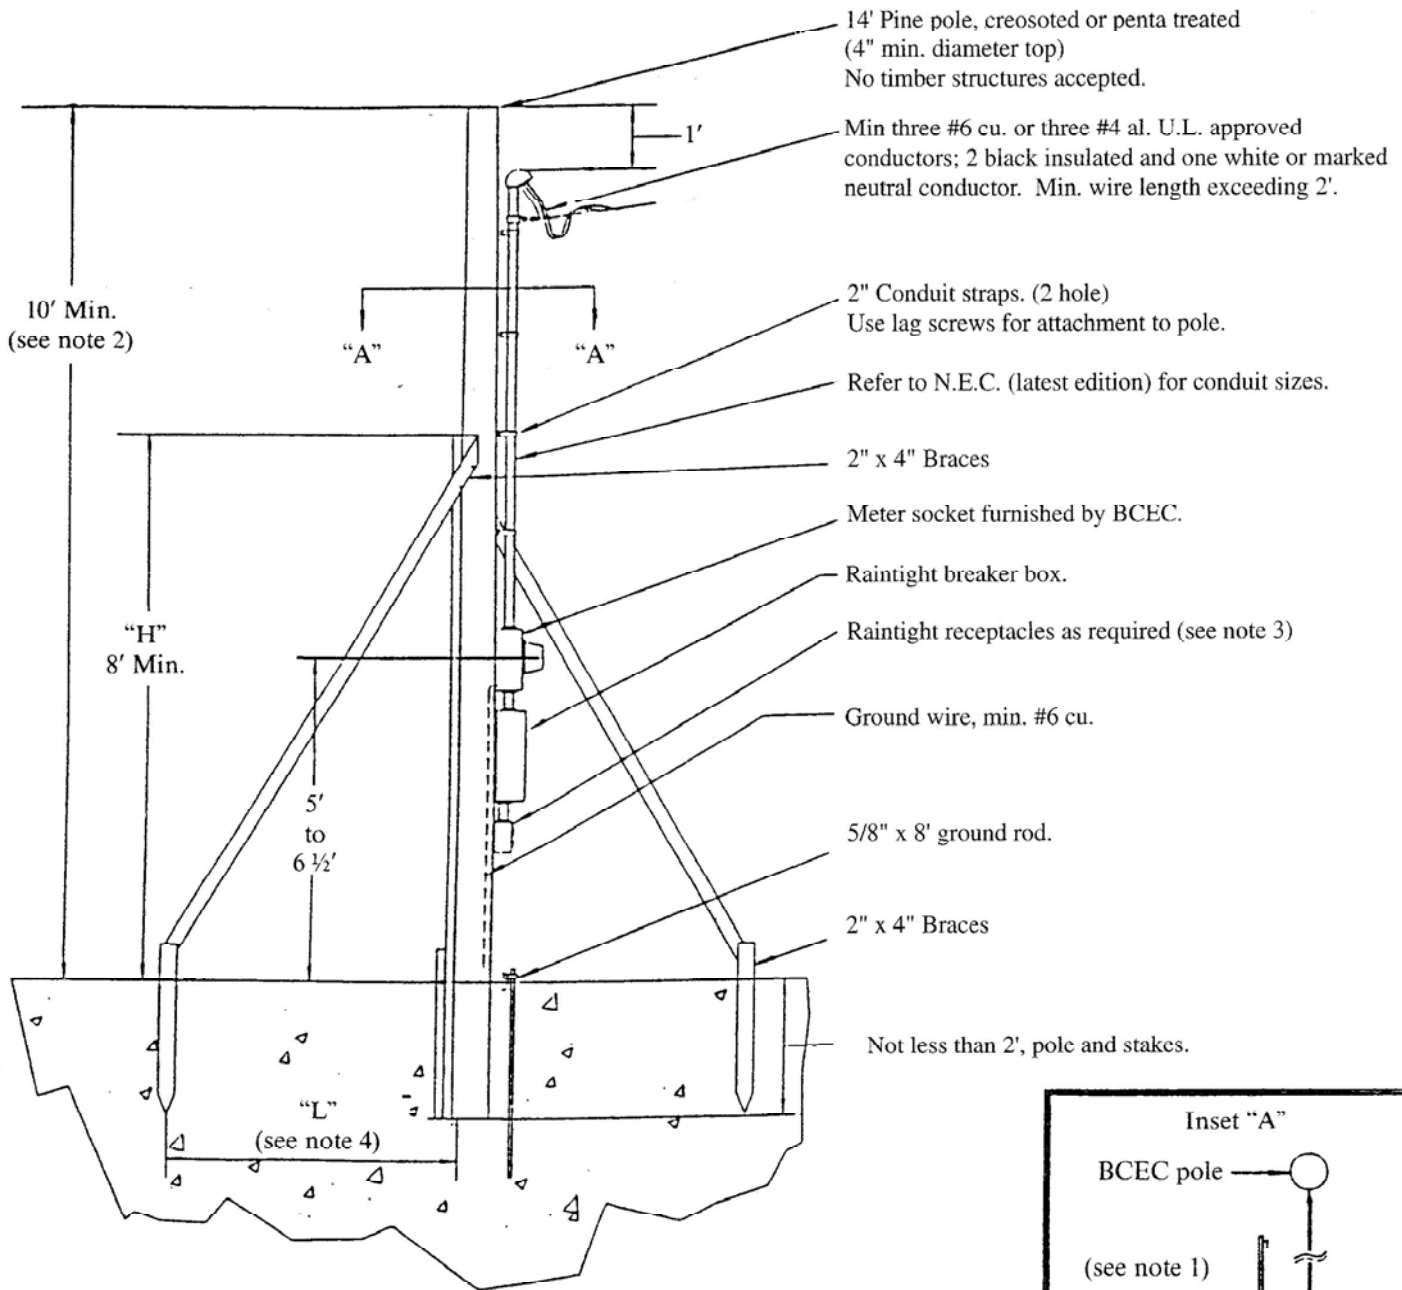

**Notes:**

1. One of the braces shall be in the direction of BCEC pole.
2. A minimum clearance of 16' over residential driveways, 18' over commercial driveways, and 22' over public streets is required.
3. Receptacles shall have approved ground fault protection per N.E.C.
4. Dimension "L" shall not be less than 1/2 of dimension "H", nor greater than dimension "H".
5. Minimum requirements only are shown on this standard and are not intended to conflict with any local code which may require more than the minimum indicated by this drawing.
6. Nails used in making temporary structures shall be 20d or larger.